


BACKFILL IN PAVED AREAS SHALL BE CRUSHED STONE, SEE SPECIFICATIONS.

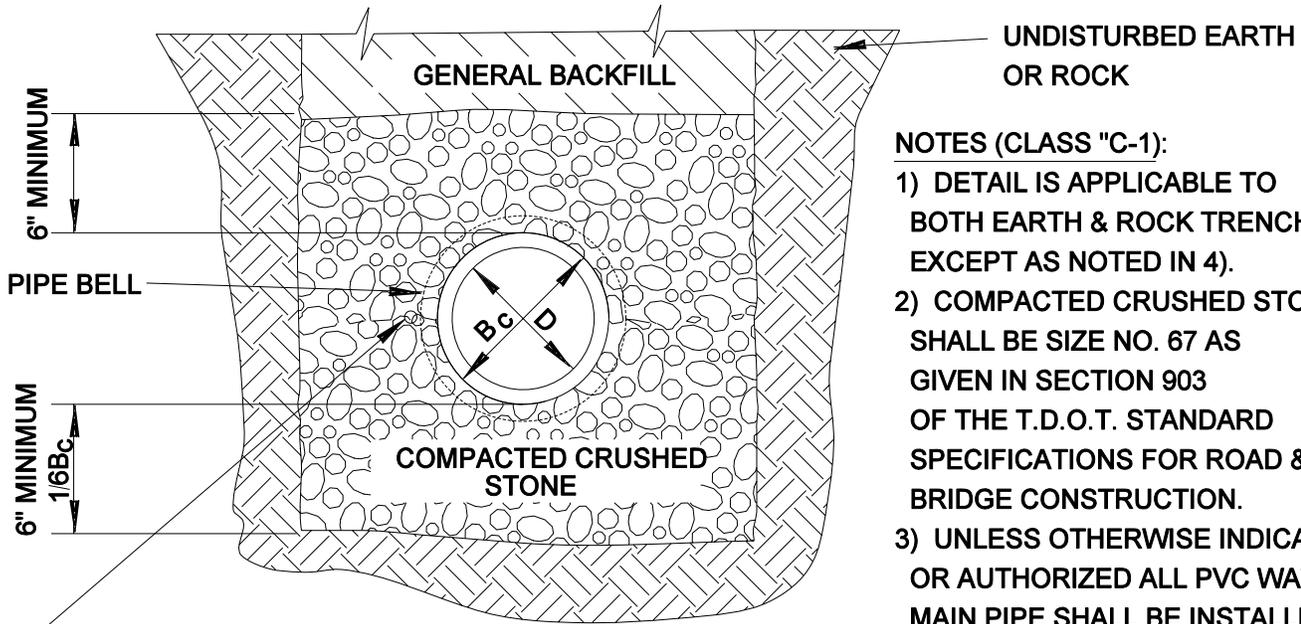


NOTES (CLASS "C-1"):

- 1) DETAIL IS APPLICABLE TO BOTH EARTH & ROCK TRENCHES. EXCEPT AS NOTED IN 4).
- 2) COMPACTED CRUSHED STONE SHALL BE SIZE NO. 67 AS GIVEN IN SECTION 903 OF THE T.D.O.T. STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION.
- 3) UNLESS OTHERWISE INDICATED OR AUTHORIZED ALL PVC WATER MAIN PIPE SHALL BE INSTALLED ON CLASS "C-1" BEDDING.
- 4) UNLESS OTHERWISE INDICATED OR AUTHORIZED ALL DUCTILE IRON WATER MAIN PIPE INSTALLED IN ROCK TRENCHES SHALL BE INSTALLED ON CLASS "C-1" BEDDING.

ONE 14 TW SOLID COPPER WIRE WITH WHITE COATING (FOR PVC PIPE ONLY).

CLASS "C-1"

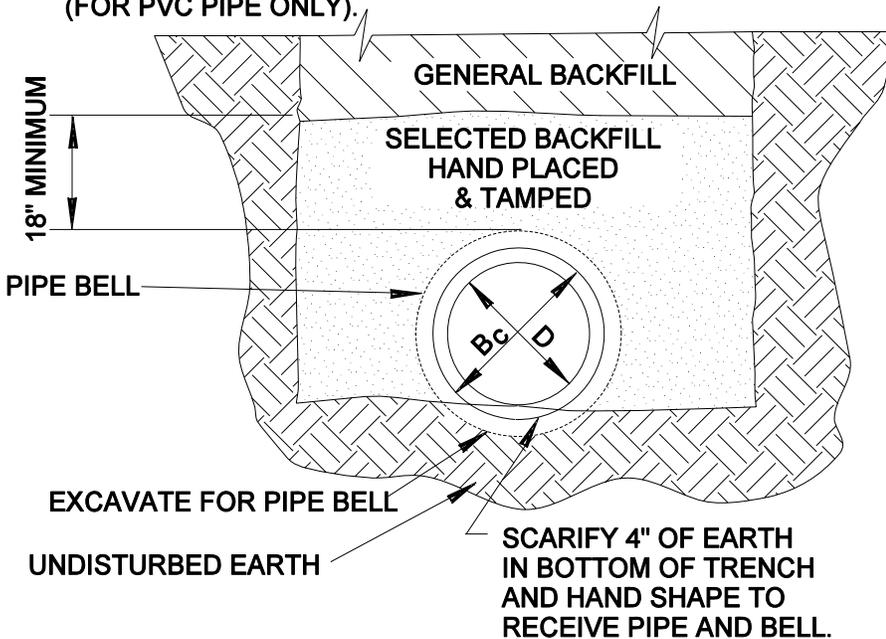

NOTES (CLASS "C-2"):

- 1) DETAIL IS APPLICABLE TO ONLY DRY, EARTH TRENCHES
- 2) UNLESS OTHERWISE INDICATED OR AUTHORIZED ALL DUCTILE IRON WATER MAIN PIPE INSTALLED IN EARTH TRENCHES SHALL BE INSTALLED ON CLASS "C-2" BEDDING
- 3) CLASS C-2 BEDDING SHALL NOT BE USED FOR PVC WATER MAINS.

CLASS "C-2"
CLASS "C" BEDDING

DRAWING NOT TO SCALE

DECEMBER 31, 1994

DRAWN BY: M.H. & A.H.W.F.
APPROVED BY: K.N.H.

BEDDING DETAILS

STANDARD
DRAWING NO.

W - 1

MURFREESBORO WATER & SEWER DEPARTMENT