


BACKFILL IN PAVED AREAS SHALL BE CRUSHED STONE. SEE SPECIFICATIONS.

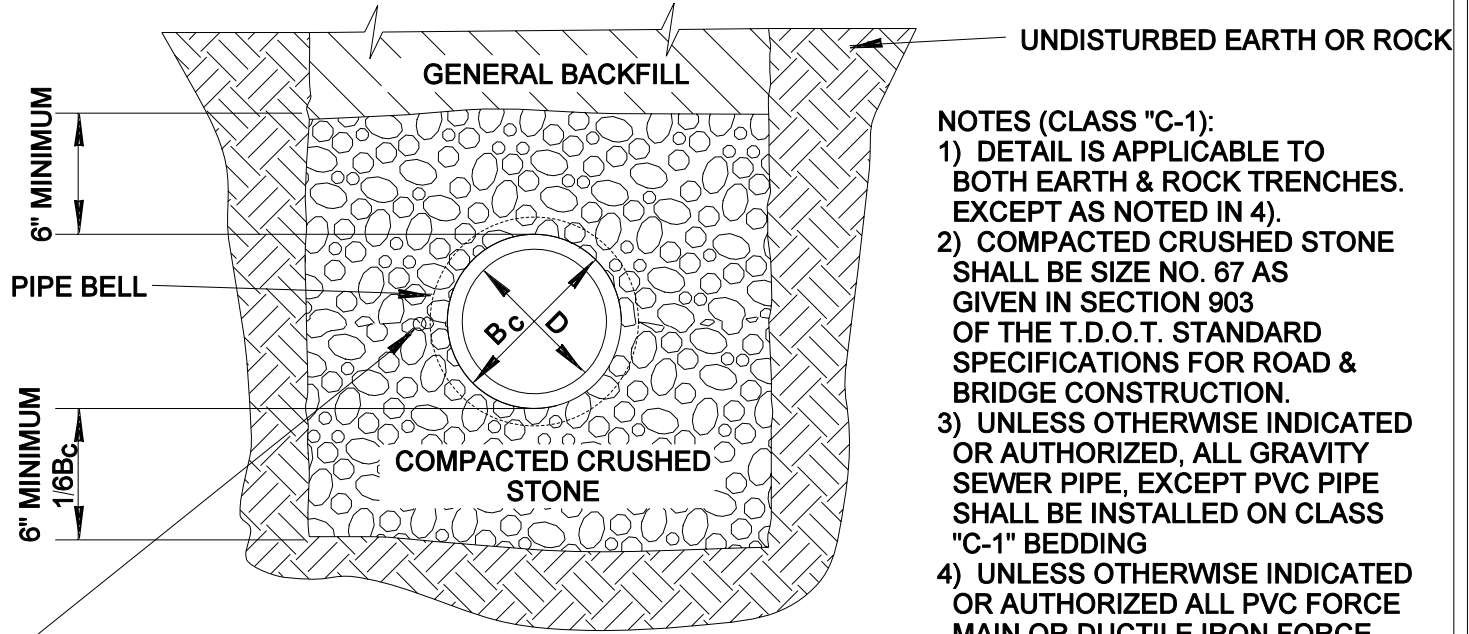

NOTES (CLASS "C-1"):

- 1) DETAIL IS APPLICABLE TO BOTH EARTH & ROCK TRENCHES. EXCEPT AS NOTED IN 4).
- 2) COMPACTED CRUSHED STONE SHALL BE SIZE NO. 67 AS GIVEN IN SECTION 903 OF THE T.D.O.T. STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION.
- 3) UNLESS OTHERWISE INDICATED OR AUTHORIZED, ALL GRAVITY SEWER PIPE, EXCEPT PVC PIPE SHALL BE INSTALLED ON CLASS "C-1" BEDDING
- 4) UNLESS OTHERWISE INDICATED OR AUTHORIZED ALL PVC FORCE MAIN OR DUCTILE IRON FORCE MAIN PIPES INSTALLED IN ROCK TRENCHES SHALL BE INSTALLED ON CLASS "C-1" BEDDING


SEE DRAWINGS S-20A & S-20B FOR ADDITIONAL BEDDING DETAILS.

NOTES (CLASS "C-2"):

- 1) DETAIL IS APPLICABLE TO ONLY DRY, EARTH TRENCHES
- 2) UNLESS OTHERWISE INDICATED OR AUTHORIZED ALL DUCTILE IRON FORCE MAIN PIPE INSTALLED IN EARTH TRENCHES SHALL BE INSTALLED ON CLASS "C-2" BEDDING
- 3) CLASS "C-2" BEDDING SHALL NOT BE USED FOR GRAVITY SEWER

ONE 14 TW SOLID COPPER WIRE WITH WHITE COATING (FOR PVC FORCE MAIN)

CLASS "C-1"

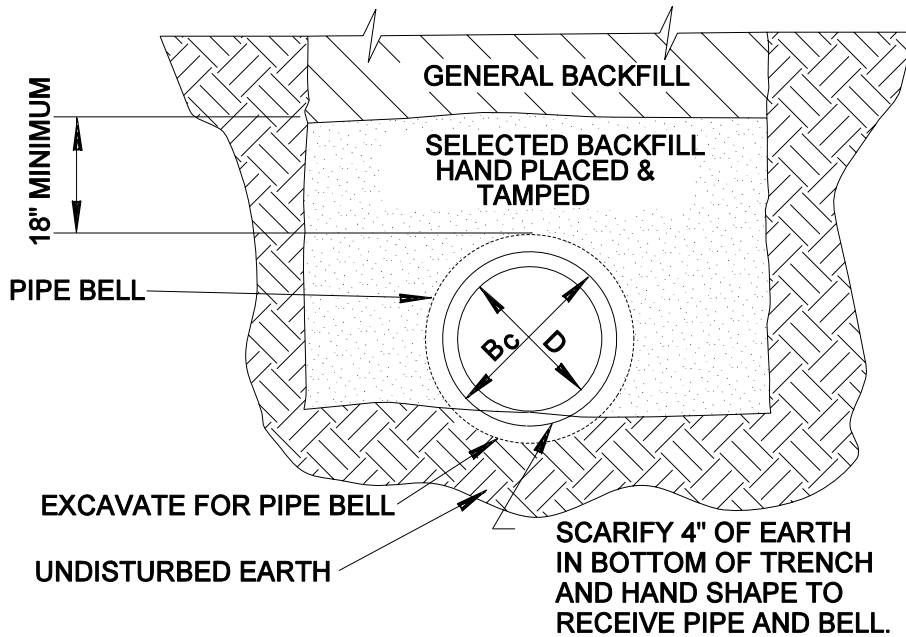

CLASS "C-2"

CLASS "C" BEDDING

DRAWING NOT TO SCALE

MAY 27, 1994

DRAWN BY: M.H. & A.H.W.F.
APPROVED BY: K.N.H.

BEDDING DETAILS

DRAWING 3 OF 3

STANDARD
DRAWING NO.

S - 20C

MURFREESBORO WATER & SEWER DEPARTMENT