


NOTE

FOR EXCAVATION IN SOLID ROCK, THE TRENCH MUST BE LINE DRILLED AND PRE-SPLIT. SEE SPECS FOR OTHER SPECIAL CONDITIONS.

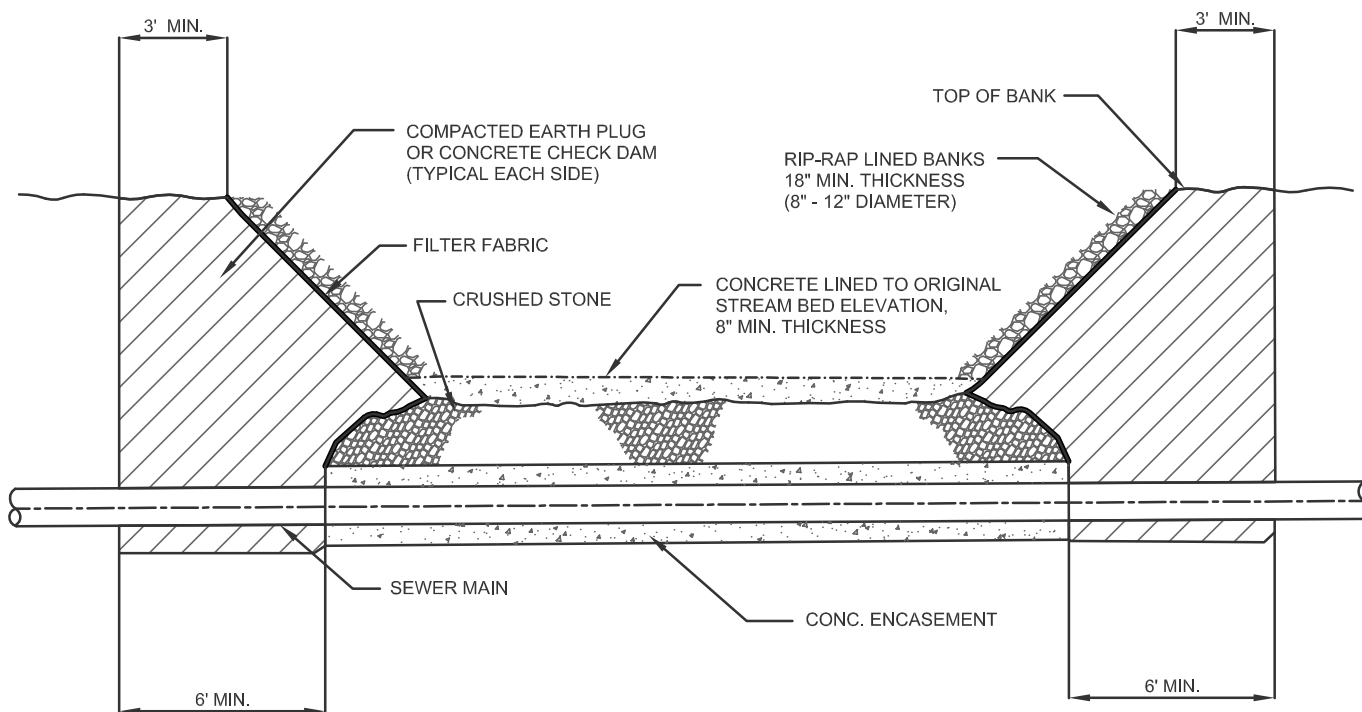

DRAWING NOT TO SCALE

NOVEMBER 18, 2009

DRAWN BY: KAC
APPROVED BY: VHS
DATE REVISED:

STREAM CROSSING DETAIL

STANDARD
DRAWING NO.

S - 16

MURFREESBORO WATER & SEWER DEPARTMENT